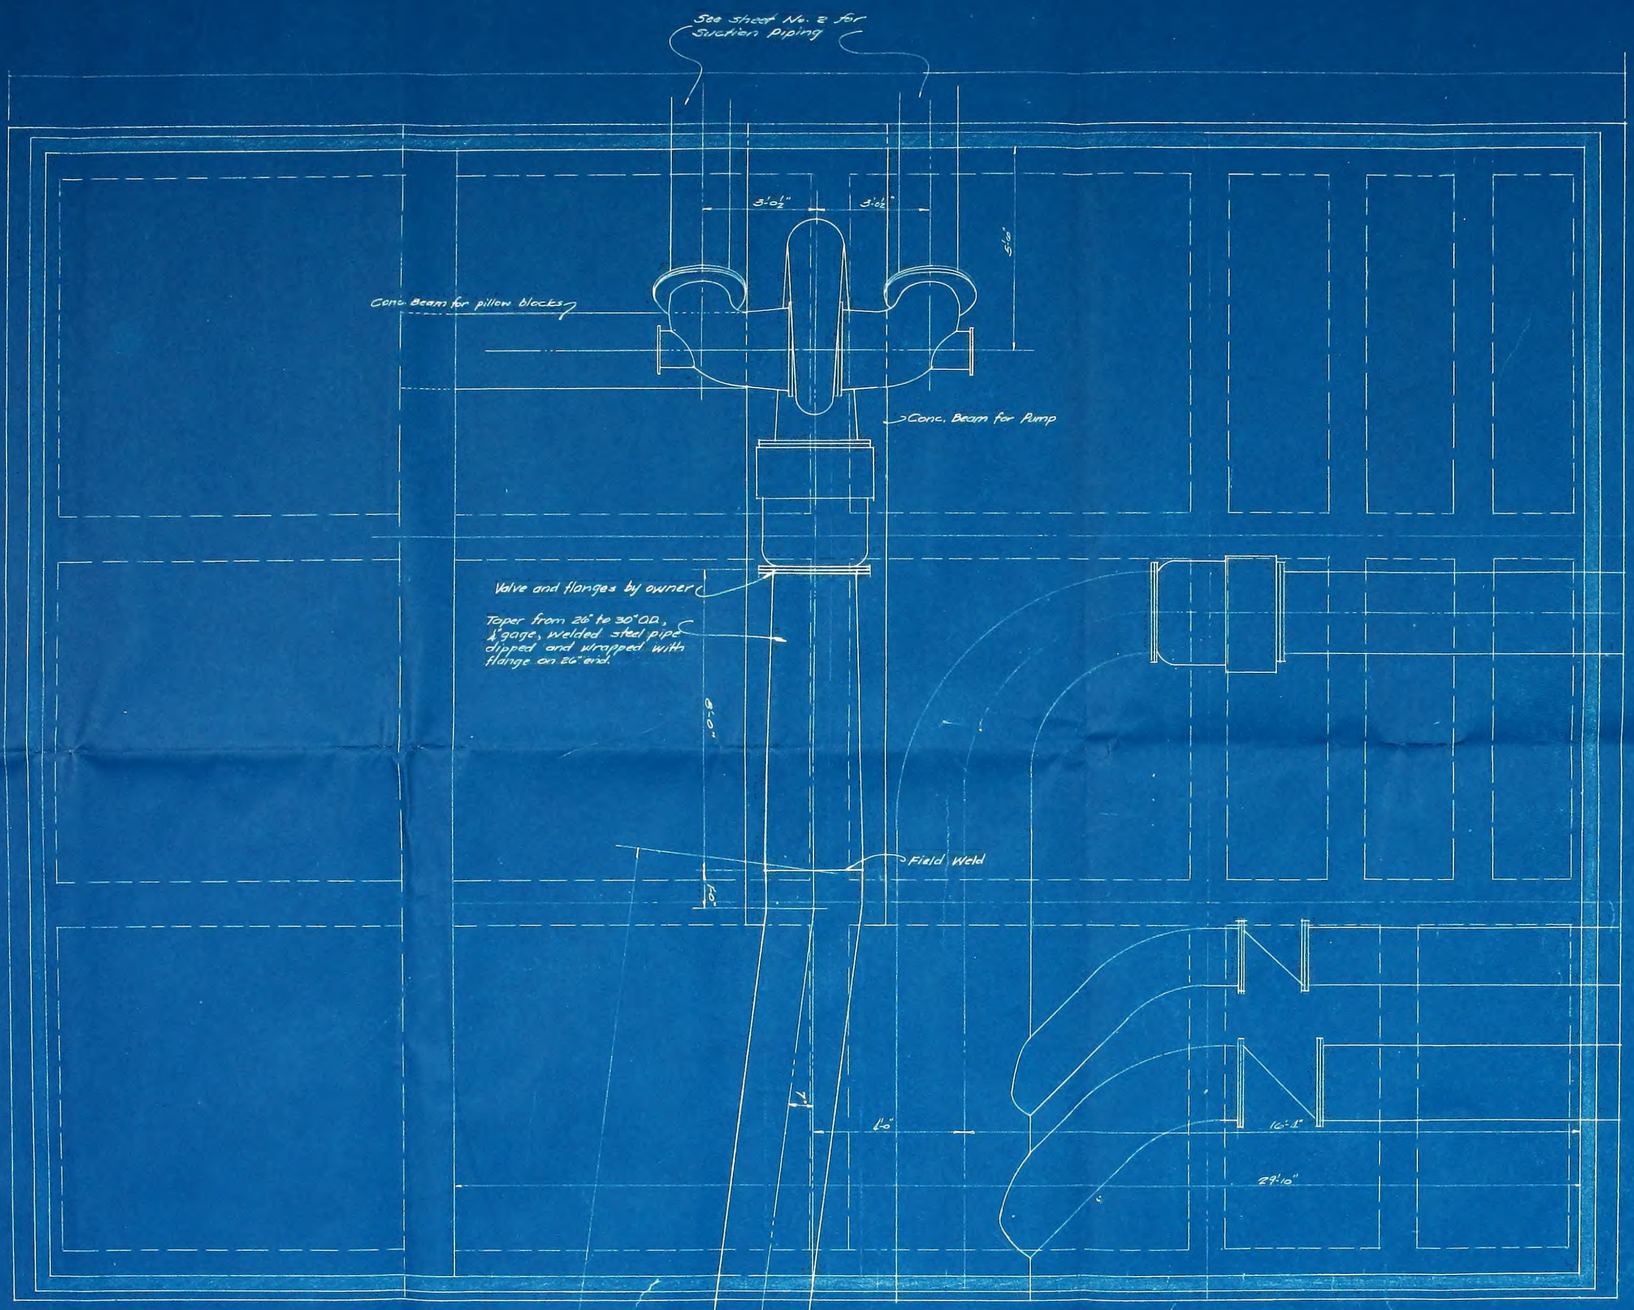
See Sheet No. 2 for Suction Piping
3'-0½"
3'-0½"
5'-0"
Conc. Beam for pillow blocks
Conc. Beam for Pump
Valve and flanges by owner
Taper from 26" to 30" O.D., ¼" gage, welded steel pipe dipped and wrapped with flange on 26" end.
8'-0"
Field Weld
5'-0"
1'-0"
1'-0"
16'-1"
29'-10"
30" O.D., ¼" gage Welded Steel Pipe, dipped and Wrapped. See Sheet No. 3 showing proposed discharge pipe.
19'-9"

PUMP HOUSE PLAN
Scale ¼"-1'-0"

PROPOSED DRAINAGE PUMP
IN
RECLAMATION DISTRICT 684

OHM & ECKLAND
CIVIL ENGINEERS
123 N. EL DORADO ST. STOCKTON, CALIFORNIA

DATE: 3-14-46	Sheet 1 of 4 Sheets
Designed By	No. 312
Checked By	File C-50

Digitized by the Internet Archive
in 2013

http://archive.org/details/proposeddrainage00ohme_1

1966.x-307.001a